




Nandi Power Generators



ISO 9001-2008 COMPANY

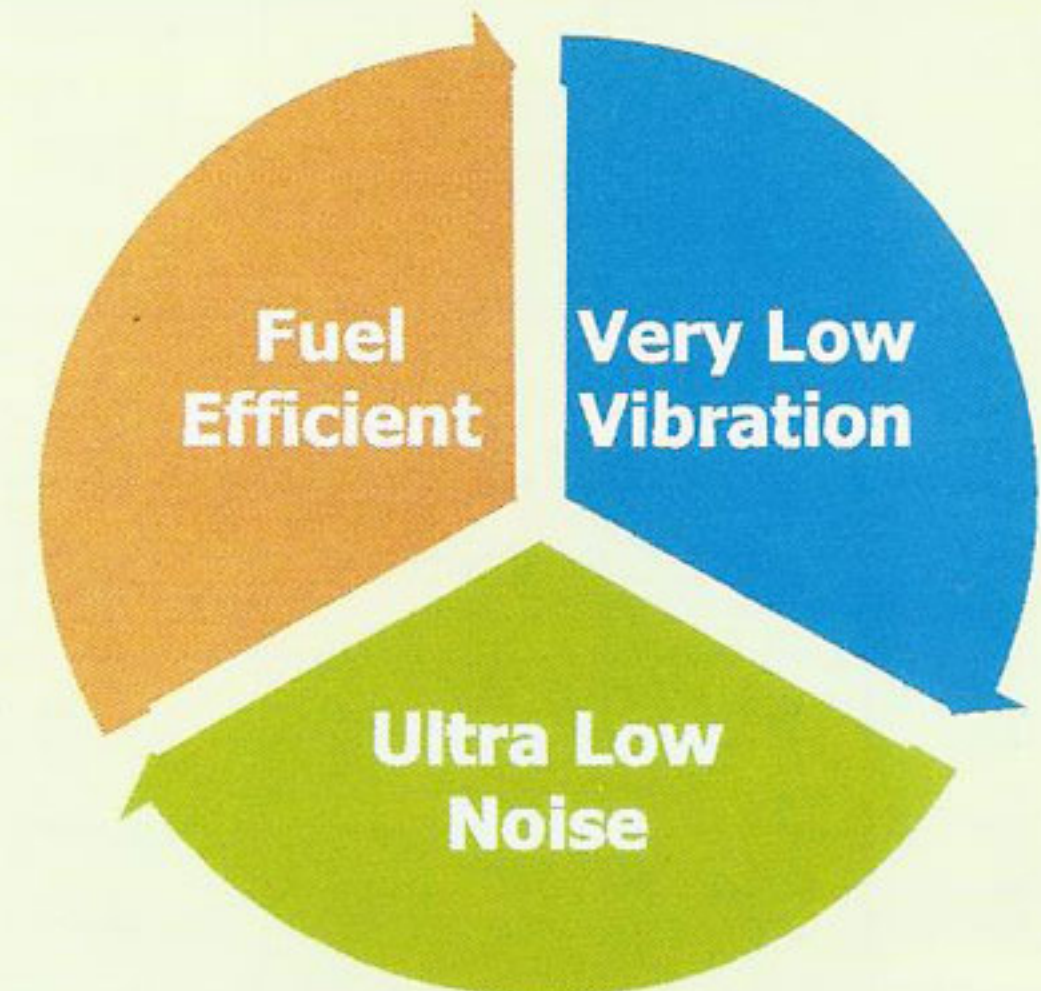

ULTIMATE
POWER
COMES NATURALLY

Our Business Life Long Customer Care and Relationship

TECHNICAL SPECIFICATIONS

KVA	KW	MODEL	BHP Rating @ 1500 RPM	LUB. OIL SUMP (LTRS)	FUEL TANK Capacity in Litres	FUEL CONSUMPTION (LTR/HR)	Recommended cable	D.G.SET DIMENSIONS IN MM		
							Alu.31/2C Core Cable Size in Sqr.mm	LENGTH	WIDTH	HEIGHT
7.5	6	2105 GL	24.3	7.5	65	1.75	10.00	1890	1170	1510
10	8	2105 GL	24.3	7.5	65	2.00	10.00	1890	1170	1510
15	12	2105 GL	24.3	7.5	65	2.50	16.00	2040	1170	1510
20	16	3100 GLI	30.4	9	85	3.75	16.00	2340	1170	1510
25	20	3100 GL	38.5	9	85	4.00	25.00	2340	1170	1510
30	24	4100 GL	48.7	11	85	5.00	25.00	2340	1170	1510
35	27	4100 GL	48.7	11	85	6.00	35.00	2340	1170	1510
40	32	4100 GLT	58.8	12	85	6.75	35.00	2540	1170	1800
45	36	4100 GLT	58.8	12	90	7.00	50.00	2540	1170	1800
50	40	4105 GLT	72.1	13	90	7.75	50.00	2540	1170	1800
62.5	50	4105 GTIC	90	14	100	9.75	70.00	2740	1320	1800

- ✓ Best in –Class Fuel economy
- ✓ Lowest in Lub oil Consumption resulting in longer life of engine
- ✓ Low Exhaust emission value i.e. Eco-Friendly
- ✓ Enriched block loading capacity to bear jerk loads
- ✓ Roughed & robust in construction hence lesser vibration
- ✓ Modular Construction for Easy interchange ability & convenient PM

Due to continuous Product improvements, specifications are subject to change without prior notice



Nandi
Power Generators

ISO 9001-2008 COMPANY

Redg. & Admin. Office : # 10, 9th Cross, Near Mathrushree Vidyanikethan, Chamundeshwari Nagar, Peenya Indl. Area, Bengaluru - 560 058. (INDIA).
Phone : 91 - 80 -28364596 / 28364618 Cell : 94484 64596, 99020 64596
e-mail : info@nandipower.net. Web site : www.nandipower.net.

Authorised GOEM For **SONALIKA**



HUBLI OFFICE :

No. 11, Behind Vijaya Hotel,
Mallikarjuna Housing Society,
Chandranatha Nagar, Hubli - 580 032.
Mobile : 9900042301

UDUPI OFFICE :

No. 136/2, Shrishukranikethana,
KHB Colony, Kumbashi - 576 257
Kundapura Taluk, Udupi Dist.
Mobile : 9900042308